

This guide provides specifications for Unitronics' Uni-I/O™ module UIS-08TC. This module comprises:

- 8 Thermocouple inputs

Uni-I/O modules are compatible with UniStream™ family of Programmable Logic Controllers. They may be either snapped onto the back of a UniStream™ HMI Panel next to a CPU-for-Panel to create an all-in-one HMI + PLC controller, or installed on a standard DIN Rail using a Local Expansion Adapter.

Installation Guides are available in the Unitronics Technical Library at www.unitronics.com

Inputs			
Number of inputs	8		
Input range ⁽¹⁾	Input type	Nominal values	Over/Under-range Values *
	Thermocouple type J	-200°C ≤ T ≤ 1,200°C (-328°F ≤ T ≤ 2,192°F)	Under-range: -210°C ≤ T < -200°C (-346°F ≤ T < -328°F) Over-range: 1,200°C < T ≤ 1,250°C (2,192°F < T ≤ 2,282°F)
	Thermocouple type K	-200°C ≤ T ≤ 1,372°C (-328°F ≤ T ≤ 2,501.6°F)	Under-range: -270°C ≤ T < -200°C (-454°F ≤ T < -328°F) Over-range: 1,372°C < T ≤ 1,400°C (2,501.6°F < T ≤ 2,552°F)
	Thermocouple type T	-200°C ≤ T ≤ 400°C (-328°F ≤ T ≤ 752°F)	Under-range: -270°C ≤ T < -200°C (-454°F ≤ T < -328°F) Over-range: 400°C < T ≤ 430°C (752°F < T ≤ 806°F)
	Thermocouple type E	-200°C ≤ T ≤ 1,000°C (-328°F ≤ T ≤ 1,832°F)	Under-range: -270°C ≤ T < -200°C (-454°F ≤ T < -328°F) Over-range: 1,000°C < T ≤ 1,010°C (1,832°F < T ≤ 1,850°F)
	Thermocouple type R	0°C ≤ T ≤ 1,768°C (32°F ≤ T ≤ 3,214.4°F)	Under-range: -50°C ≤ T < 0°C (-58°F ≤ T < 32°F) Over-range: 1,768°C < T ≤ 1,800°C (3,214.4°F < T ≤ 3,272°F)
	Thermocouple type S	0°C ≤ T ≤ 1,768°C (32°F ≤ T ≤ 3,214.4°F)	Under-range: -50°C ≤ T < 0°C (-58°F ≤ T < 32°F) Over-range: 1,768°C < T ≤ 1,800°C (3,214.4°F < T ≤ 3,272°F)

	Thermocouple type B	200°C ≤ T ≤ 1,820°C (392°F ≤ T ≤ 3,308°F)	Under-range: 100°C ≤ T < 200°C (212°F ≤ T < 392°F) Over-range: 1,820°C < T ≤ 1,870°C (3,308°F < T ≤ 3,398°F)
	Thermocouple type N	-210°C ≤ T ≤ 1,300°C (-346°F ≤ T ≤ 2,372°F)	Under range: -270°C ≤ T < -210°C (-454°F ≤ T < -346°F) Over-range: 1,300°C < T ≤ 1,350°C (2,372°F < T ≤ 2,462°F)
	Thermocouple type C	10°C ≤ T ≤ 2,315°C (50°F ≤ T ≤ 4,199°F)	Under-range: 0°C ≤ T < 10 °C (32°F ≤ T < 50°F) Over-range: 2,315 °C < T ≤ 2,370 °C (4,199°F < T ≤ 4,298°F)
	Voltage	-70mV ≤ Voltage ≤ 70mV	Under-range: -71.05mV ≤ Voltage < -70mV Over-range: 70mV ≤ Voltage < 71.05mV
	* Overflow or Underflow ⁽¹⁾ is declared when an input value exceeds the Over-range or Under-range boundaries respectively.		
Absolute maximum rating	±36 V		
Isolation voltage			
Input to bus	500 VAC for 1 minute		
Input to input	120 VAC for 1 minute		
Input power supply to Bus	500 VAC for 1 minute		
Input power supply to input	500 VAC for 1 minute		
Conversion method	Delta-sigma		
Resolution	Thermocouple – 0.1°C (0.1°F) ⁽⁴⁾ Voltage – 15 bits plus sign		
Accuracy ⁽⁴⁾ (25°C / -20°C to 55°C)	Input type	Accuracy	
	Thermocouple type J	± 0.4°C / ± 0.7°C (± 0.72°F / ± 1.26°F)	
	Thermocouple type K	± 0.5°C / ± 1.0°C (± 0.9°F / ± 1.8°F)	
	Thermocouple type T	± 0.6°C / ± 1.2°C (± 1.08°F / ± 2.16°F)	
	Thermocouple type E	± 0.4°C / ± 0.8°C (± 0.72°F / ± 1.44°F)	
	Thermocouple type R	± 1.2°C / ± 2.4°C (± 2.16°F / ± 4.32°F)	
	Thermocouple type S	± 1.2°C / ± 2.4°C (± 2.16°F / ± 4.32°F)	
	Thermocouple type B	± 2.0°C / ± 3.8°C (± 3.46°F / ± 6.84°F)	
	Thermocouple type N	± 1.0°C / ± 1.5°C (± 1.8°F / ± 2.7°F)	
	Thermocouple type C	± 0.8°C / ± 2.0°C (±1.44°F / ± 3.46°F)	
Voltage	± 0.05% / ± 0.1% of full scale		

Noise rejection	10Hz, 50 Hz, 60 Hz, 400 Hz				
Step response ⁽⁴⁾ (0 to 100% of final value)	Smoothing (filter)	Noise Rejection Frequency			
		400Hz	60Hz	50Hz	10Hz
	None	310ms	470ms	550ms	2,470ms
	Weak	1,236ms	1,875ms	2,195ms	9,875ms
	Medium	2,470ms	3,750ms	4,390ms	19,750ms
Strong	4,940ms	7,500ms	8,780ms	39,500ms	
Update time ⁽⁴⁾	Noise Rejection Frequency		Update Time		
	400Hz		310ms		
	60Hz		470ms		
	50Hz		550ms		
	10Hz		2,470ms		
Cold junction error	$\pm 1.5^{\circ}\text{C}$ ($\pm 2.7^{\circ}\text{F}$)				
Cable	Shielded, see installation guide for details				
Diagnostics ⁽⁶⁾ ⁽⁷⁾	Input Overflow or Underflow, sensor connection fault ⁽⁶⁾ ⁽⁷⁾				

IO/COM Bus


Bus current consumption	80mA maximum
-------------------------	--------------

LED Indications


Input LEDs	Red	On: Input value is in Overflow, Underflow, or a connection fault occurs		
Status LED	A triple color LED. Indications are as follows:			
	Color	LED State	Status	
	Green	On	Operating normally	
		Slow blink	Boot	
		Rapid blink	OS initialization	
	Green/Red	Slow blink	Configuration mismatch	
	Red	Slow blink	No IO exchange	
		Rapid blink	Communication error	
Orange	Rapid Blink	OS Upgrade		

Environmental	
Protection	IP20, NEMA1
Operating temperature	-20°C to 55°C (-4°F to 131°F)
Storage temperature	-30°C to 70°C (-22°F to 158°F)
Relative Humidity (RH)	5% to 95% (non-condensing)
Operating altitude	2,000 m (6,562 ft)
Shock	IEC 60068-2-27, 15G, 11ms duration
Vibration	IEC 60068-2-6, 5Hz to 8.4Hz, 3.5mm constant amplitude, 8.4Hz to 150Hz, 1G acceleration


Dimensions	
Weight	100 g (0.220 lb)
Size	Refer to the images below

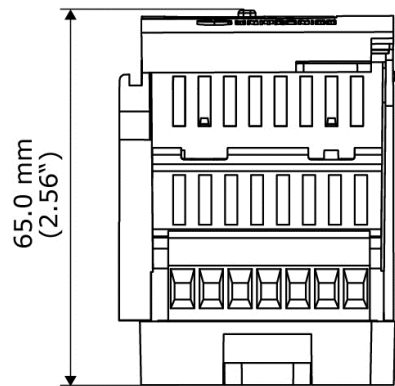

Bottom View

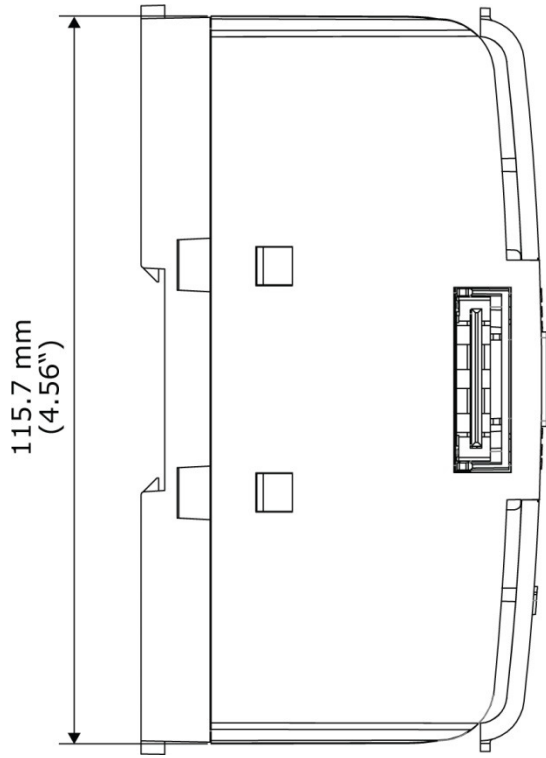

Side View

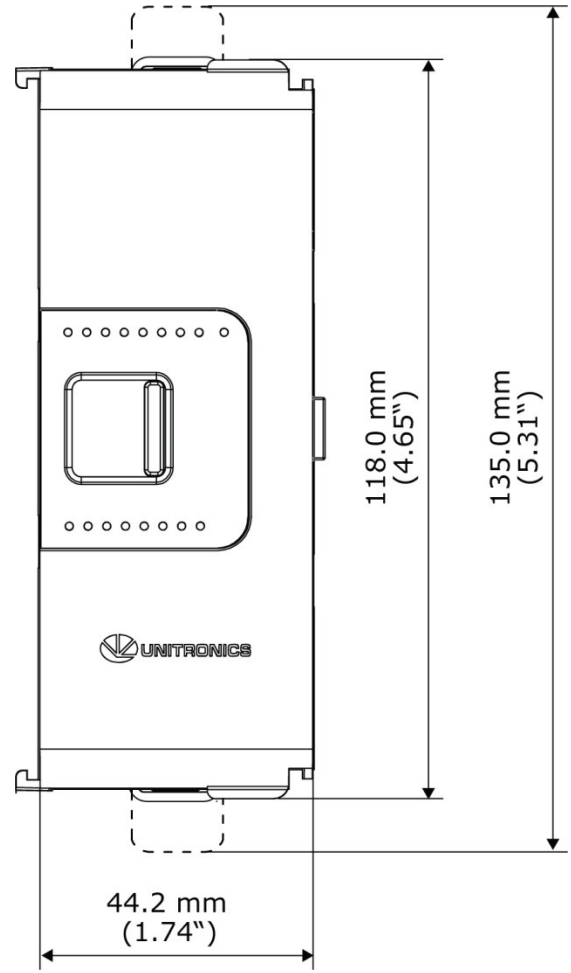

Front View

Notes:

1. The UIS-08TC measures values that are slightly higher or lower than the nominal input range (i.e. Input Over/Under-range respectively).
Note that when input Overflow, Underflow or a connection fault occurs, it is indicated in the corresponding I/O Status tag (refer to the UniLogic™ help for details) as well as by the respective input LED (see LED Indications), while the input value is registered as follows:

Fault Type	Registered Value in the Input Tag
Overflow	32,767
Underflow	-32,767
Connection fault	-32,768

2. For temperature measurement, the value is represented in 0.1° units. For example, a temperature Of 12.3° is represented as 123 at the Value tag.
3. The internal cold junction accuracy is ±1°C for all thermocouple types. This accuracy adds to the accuracy in the table. The module requires at least 30 minutes of warm-up in order to meet the table specifications.
4. Step response and update time are independent of the number of inputs that are used.
5. See LED Indications Table above for description of the relevant indications. Note that the diagnostics results are also indicated in the I/O tags and can be observed through the UniApps™ or the online state of the UniLogic™.
6. Sensor connection fault check is active by default for both temperature and voltage measurements.
7. Sensor connection fault check may interfere with some test equipment like thermocouple/voltage simulators and thus may induce reading errors or cause malfunction of the test equipment and/or the UIS-08TC.

In order to interoperate correctly with such equipment, you may set the Disable Fault Detection I/O tag. This will disable connection fault check for all inputs.

Note that when this tag is set, the UIS-08TC will not check, or report, connection faults; thus, the reading in such case is unpredictable.

The information in this document reflects products at the date of printing. Unitronics reserves the right, subject to all applicable laws, at any time, at its sole discretion, and without notice, to discontinue or change the features, designs, materials and other specifications of its products, and to either permanently or temporarily withdraw any of the forgoing from the market.

All information in this document is provided "as is" without warranty of any kind, either expressed or implied, including but not limited to any implied warranties of merchantability, fitness for a particular purpose, or non-infringement. Unitronics assumes no responsibility for errors or omissions in the information presented in this document. In no event shall Unitronics be liable for any special, incidental, indirect or consequential damages of any kind, or any damages whatsoever arising out of or in connection with the use or performance of this information.

The tradenames, trademarks, logos and service marks presented in this document, including their design, are the property of Unitronics (1989) (R"G) Ltd. or other third parties and you are not permitted to use them without the prior written consent of Unitronics or such third party as may own them.

DOC27023-A6 09/14